



Planning Guide

for Residential Elevators
ASME A17.1, Part V, Section 5.3

September 1, 2008



Also includes planning information for
upgrading to a Signet Luxury Cab!

SIGNET

ThyssenKrupp Access
Residential Elevator Division



ThyssenKrupp

Introduction

This Planning Guide is designed to assist architects, contractors, home owners and elevator professionals in planning for a home elevator that meets the requirements of ASME A17.1 Part V Section 5.3.

We strongly recommend you contact the codes authority having jurisdiction in the area(s) where the elevator will be installed. Become familiar with all requirements governing the installation and use of elevators in private residences. It is extremely important for you to know and adhere to all regulations concerning installation and use of elevators.

IMPORTANT NOTICE:

This Planning Guide provides nominal dimensions and specifications useful for INITIAL planning of an elevator project. BEFORE beginning actual construction, be sure to receive application drawings customized with specifications and dimensions for your specific project. Call 1-425-821-3160 or visit our website www.primariuselevators.com and click on "Request Information".

Elevator configurations and dimensions are in accordance with our interpretation of the standards set forth by ASME A17.1 Part V Section 5.3. Please consult ThyssenKrupp Access or an authorized dealer in your area for more specific information pertaining to your project, including any deviation between referenced standards and those of any local codes or laws. Always contact local codes authorities for any variation to standards.

The dimensions and specifications in this Planning Guide are subject to constant change (without notice) due to product enhancements and continually evolving codes and product applications.

This elevator requires 230 VAC (208 VAC minimum - 256 VAC maximum), single phase 60 Hz circuit with neutral and ground. 20 amp circuit for gearless drive.

Steps of planning for a Volant Home Elevator:

1. Determine customer's intention for use.
2. Determine code requirements of site.
3. Determine installation parameters of site.
4. Determine the car type and hoistway size requirements (see pages 4 and 5).

Contents

Equipment for Volant residential elevator	3
Hoistway size requirements (pocket gates)	4-8
Hoistway construction notes	9
Guide rail backing construction details	9
Rail reactions.....	9
Typical gearless drive area construction details	10
Service Access Hatch	11
Description of features	12-14
3-Part specifications.....	15-18
Gearless drive overview	19

EQUIPMENT FOR Volant RESIDENTIAL ELEVATOR

This elevator meets the requirements of ASME A17.1 Part V, Section 5.3 for a residential elevator.

General:

- Speed: 40 fpm (.20ms)
- Minimum pit depth: 12"
- Maximum travel: 50'
- Maximum number of stops: 5 (minimum 17" travel between stops)

Mechanical Equipment:

- Modular Dual 6³/₄ lb. T-rail system
- Sling assembly

Car and Appointments:

- 36" x 48" (12 ft²) x 84" high car size
- Melamine wall panels in choice of champagne, light oak, dark oak or white
- White ceiling
- Two recessed halogen lights
- Wooden handrail to match wall panels
- Accordion car gate in choice of champagne, chalk, light oak, dark oak or white
- Unfinished plywood floor (with removable insert for ³/₄" thick finished floor by others)
- Telephone (integrated into COP)

Controls:

- Programmable Logic Controller (PLC) with digital signal processor
- Fully automatic operation
- Car operating panel (brushed stainless steel or brass) with LED floor position/diagnostic display and call acknowledgment
- Hall stations (brushed stainless steel or brass) with LED floor position/diagnostic display and call acknowledgment
- Automatic car lighting with constant on switch
- Automatic homing to a designated floor
- Bi-directional leveling
- Emergency stop switch
- Emergency alarm button
- Hoistway wiring with conduit (hall stations / interlocks)

Safety Devices:

- Lockable auxiliary switch for car lighting circuit
- Lockable auxiliary switch for drive unit circuit
- Upper and lower terminal limits
- Final limits (2 upper, 1 lower)

- Pit switch
- Car top stop switch
- Battery backup emergency light and alarm
- Car gate safety switch
- Electromechanical interlocks (for doors by others)
- Overspeed Governor

Options:

- 36" x 60" (15 ft²) or 40" x 54" (15 ft²) car sizes (custom sizes are available in 2" increments from 36" to 42" width by 48" to 60" depth -12 ft² minimum, 15 ft² maximum)
- Special car size (15 ft² maximum, 12 ft² minimum)
- 88" or 94" inside car heights (requires additional overhead space)
- Unfinished wood veneer panels (oak, cherry, maple or birch)
- Unfinished inset wood veneer panel walls (oak, cherry, maple or birch)
- Factory applied finish to wood veneer panels and handrail
- Raised wood panel walls (oak, cherry, maple or birch) with choice of finish. See available finishes at www.tkaccess.com/minwax
- Matching wood veneer ceiling panel*
- Hall stations and car operating panel can be provided in polished stainless steel or brass
- Metal handrail* (brushed stainless steel or brass, or polished stainless steel or brass)
- Automatic car gate operator with light beam safety curtain
- Automatic hoistway door operator
- Car Buffer springs (requires 12" deep pit minimum)

Car Gate Upgrades:

- Accordion car gate with 3 clear vision panels
- Accordion car gate with all clear vision panels
- Deluxe Visifold® accordion car gate
- Accordion car gate with solid aluminum panels (clear or brass anodized finish)
- Accordion car gate with perforated aluminum panels (clear or brass anodized finish)

Control Upgrades:

- Key switch controls in car operating panel and/or hall stations

*Not available with melamine wall panels.

Gearless drive specific features:

General:

- Rated load: 950 lbs. (430 kg) (750 and 700 lbs. available)
- Minimum overhead clearance 9'-0"

Mechanical Equipment:


- 230 VAC, 60 Hz, 20 amp single phase power supply with neutral and ground (4 wires)
- Two ³/₈" diameter 8x19 Traction Rope
- Frequency controlled variable speed gearless machine

Safety Devices:

- Slack rope safety device


Custom sizes are available in 2" increments from 36" to 42" width by 48" to 60" depth (12 ft² minimum, 15 ft² maximum). Consult ThyssenKrupp Access for hoistway details.

**Type 1 - Left Hand Car with Pocket Gate
Gate Stack - Opposite Rail**

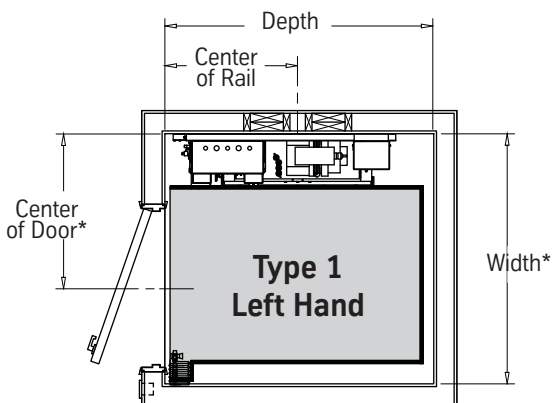


Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	56 1/4"*	55"	28 1/2"	30 3/4"*	32 1/8"
36 x 60	56 1/4"*	67"	32 7/8"	30 3/4"*	32 1/8"
40 x 54	60 1/4"*	61"	30 1/8"	30 3/4"*	35 7/8"

**Type 1 - Right Hand Car with Pocket Gate
Gate Stack - Opposite Rail**

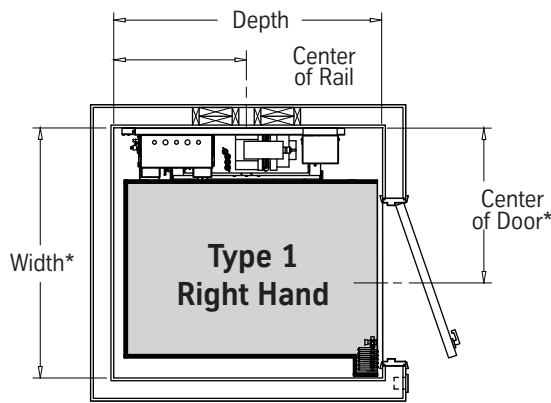


Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	56 1/4"*	55"	26 1/2"	30 3/4"*	32 1/8"
36 x 60	56 1/4"*	67"	33"	30 3/4"*	32 1/8"
40 x 54	60 1/4"*	61"	30"	30 3/4"*	35 7/8"

**Type 1 - Left Hand Car with Pocket Gate
Gate Stack - Rail Side**

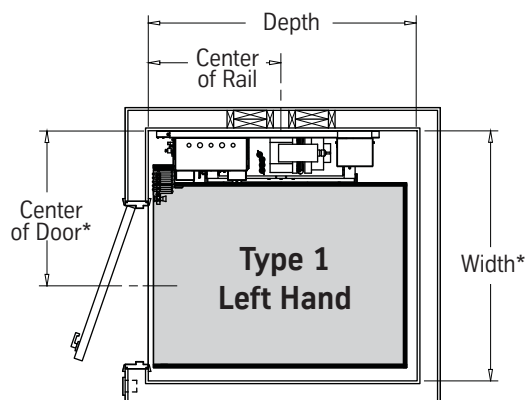

Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	52 3/4"*	55"	28 1/2"	30 3/4"*	32 1/8"
36 x 60	52 3/4"*	67"	32 7/8"	30 3/4"*	32 1/8"
40 x 54	56 3/4"*	61"	30 1/8"	35"*	35 7/8"


**Type 1 - Right Hand Car with Pocket Gate
Gate Stack - Rail Side**

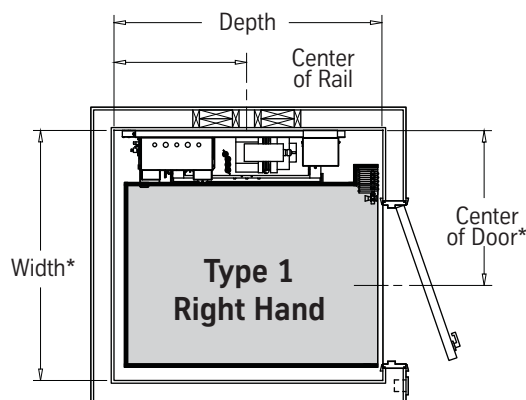

Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	52 3/4"*	55"	26 1/2"	30 3/4"*	32 1/8"
36 x 60	52 3/4"*	67"	33"	30 3/4"*	32 1/8"
40 x 54	56 3/4"*	61"	30"	35"*	35 7/8"


If this configuration is used with an automatic gate operator, a remote controller or 9'-0" overhead is required.

Type 2 - Straight-thru Car with Pocket Gates
Gate Stack - Opposite Rail

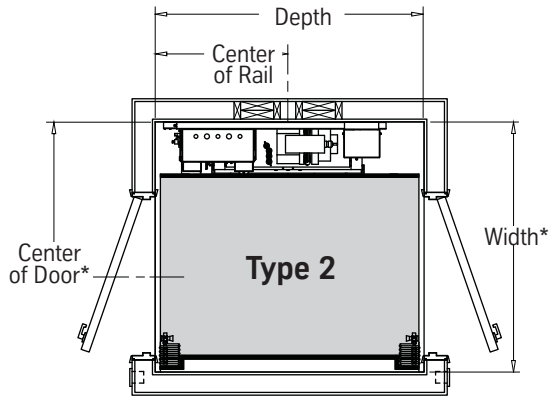

Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	56 ¹ / ₄ "*	55 ¹ / ₂ "	29 ¹ / ₄ "	30 ³ / ₄ "**	32 ¹ / ₈ "
36 x 60	56 ¹ / ₄ "*	67 ¹ / ₂ "	33 ³ / ₄ "	30 ³ / ₄ "**	32 ¹ / ₈ "
40 x 54	60 ¹ / ₄ "*	61 ¹ / ₂ "	30 ³ / ₄ "	30 ³ / ₄ "**	35 ⁷ / ₈ "

Type 2 - Straight-thru Car with Pocket Gates
Gate Stack - Rail Side

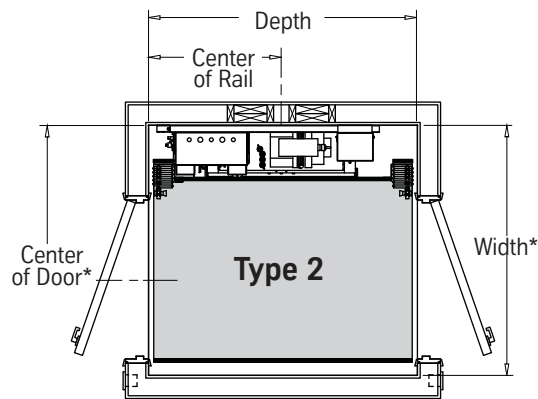


Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	52 ³ / ₄ "*	55 ¹ / ₂ "	29 ¹ / ₄ "	30 ³ / ₄ "**	32 ¹ / ₈ "
36 x 60	52 ³ / ₄ "*	67 ¹ / ₂ "	33 ³ / ₄ "	30 ³ / ₄ "**	32 ¹ / ₈ "
40 x 54	56 ³ / ₄ "*	61 ¹ / ₂ "	30 ³ / ₄ "	35"	35 ⁷ / ₈ "

If this configuration is used with an automatic gate operator, a remote controller or 9'-6" overhead is required.

Note: All dimensions are to inside finished walls.

Type 3 - Car with Pocket Gate


Pocket gate only available with gate stack on rail side.

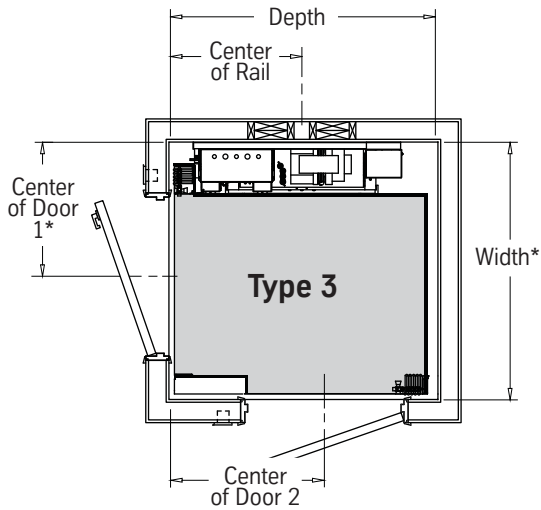

Car Size	Width	Depth	Center of Rail	Center Door 1	Center Door 2	Clearance of Door 1	Clearance of Door 2
36 x 48	54 ³ / ₈ "	55"	28 ¹ / ₂ "	30 ³ / ₄ "	33 ¹ / ₂ " 33 ¹ / ₄ "†	32 ¹ / ₈ "	28 ⁵ / ₈ "
36 x 60	54 ³ / ₈ "	67"	32 ⁷ / ₈ "	30 ³ / ₄ "	45 ¹ / ₂ " 41 ³ / ₄ "†	32 ¹ / ₈ "	32 ¹ / ₈ "
40 x 54	58 ³ / ₈ "	61"	30 ¹ / ₈ "	35"	39 ¹ / ₂ " 35 ¹ / ₄ "†	35 ¹ / ₈ "	32 ¹ / ₈ "

† Dimension when car gate is mounted opposite side from what is shown.

If this configuration is used with an automatic gate operator, a remote controller or 9'-0" overhead is required.

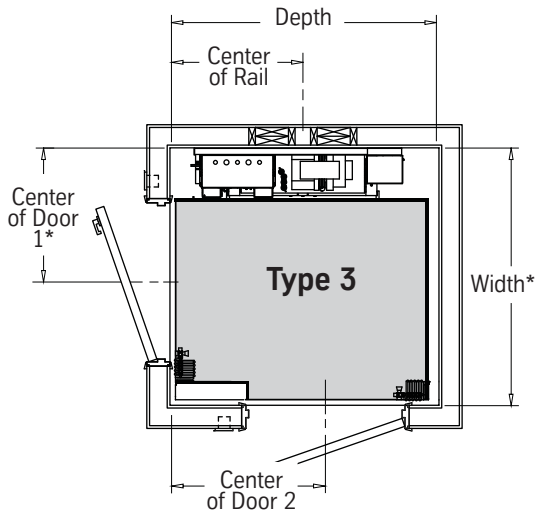


Car Size	Width	Depth	Center of Rail	Center Door 1	Center Door 2	Clearance of Door 1	Clearance of Door 2
36 x 48	54 ³ / ₈ "	55"	28 ¹ / ₂ "	30 ³ / ₄ "	33 ¹ / ₂ " 33 ¹ / ₄ "†	32 ¹ / ₈ "	28 ⁵ / ₈ "
36 x 60	54 ³ / ₈ "	67"	32 ⁷ / ₈ "	30 ³ / ₄ "	45 ¹ / ₂ " 41 ³ / ₄ "†	32 ¹ / ₈ "	32 ¹ / ₈ "
40 x 54	58 ³ / ₈ "	61"	30 ¹ / ₈ "	30 ³ / ₄ "	39 ¹ / ₂ " 35 ¹ / ₄ "†	35 ¹ / ₈ "	32 ¹ / ₈ "

† Dimension when car gate is mounted opposite side from what is shown.

Type 4 - Car with Pocket Gate

Pocket gate only available with gate stack on rail side.

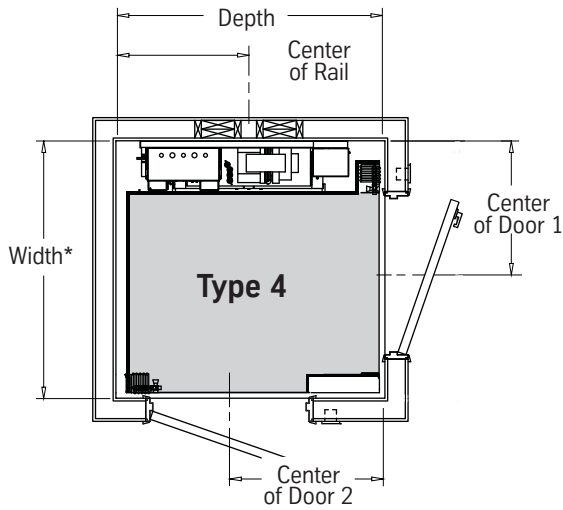


Car Size	Width	Depth	Center of Rail	Center of Door 1	Center of Door 2	Clearance of Door 1	Clearance of Door 2
36 x 48	54 ³ / ₈ "	55"	26 ¹ / ₂ "	30 ³ / ₄ "	33 ¹ / ₂ " 33 ¹ / ₄ "†	32 ¹ / ₈ "	28 ⁵ / ₈ "
36 x 60	54 ³ / ₈ "	67"	33"	30 ³ / ₄ "	45 ¹ / ₂ " 41 ³ / ₄ "†	32 ¹ / ₈ "	32 ¹ / ₈ "
40 x 54	58 ³ / ₈ "	61"	30 ¹ / ₈ "	35"	39 ¹ / ₂ " 35 ¹ / ₄ "†	35 ¹ / ₈ "	32 ¹ / ₈ "

† Dimension when car gate is mounted opposite side from what is shown.

Note:



All dimensions are to inside finished walls.

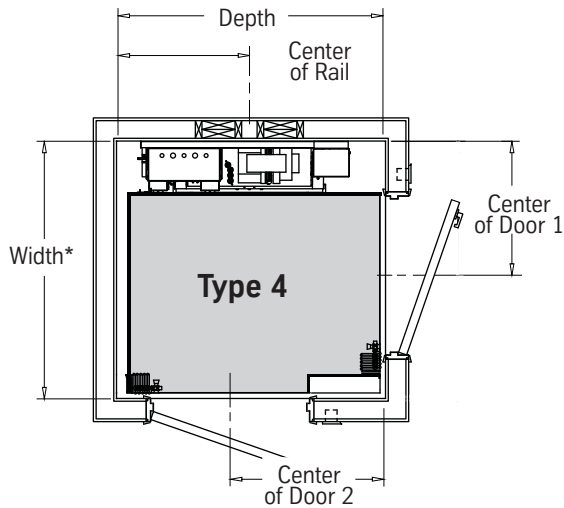

Car Size	Width	Depth	Center of Rail	Center Door 1	Center Door 2	Clearance of Door 1	Clearance of Door 2
36 x 48	54 ³ / ₈ "	55"	26 ¹ / ₂ "	30 ³ / ₄ "	33 ¹ / ₂ " 33 ¹ / ₄ "†	32 ¹ / ₈ "	28 ⁵ / ₈ "
36 x 60	54 ³ / ₈ "	67"	33"	30 ³ / ₄ "	45 ¹ / ₂ " 41 ³ / ₄ "†	32 ¹ / ₈ "	32 ¹ / ₈ "
40 x 54	58 ³ / ₈ "	61"	30 ¹ / ₈ "	30 ³ / ₄ "	39 ¹ / ₂ " 35 ¹ / ₄ "†	35 ¹ / ₈ "	32 ¹ / ₈ "

† Dimension when car gate is mounted opposite side from what is shown.

Type 5 Cars - Enter/Exit Adjacent Side with Standard Gate (no pocket gate on this type car)

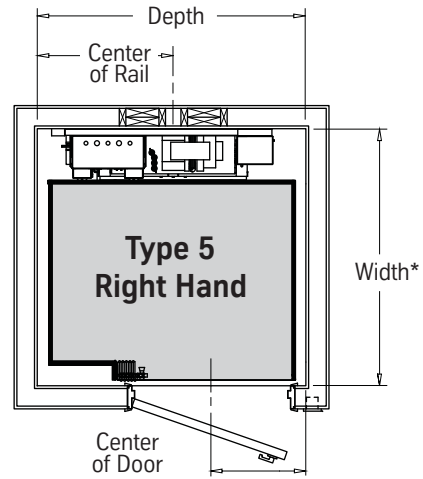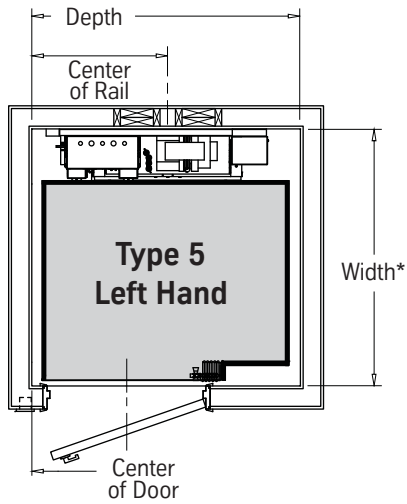

Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	54 ³ / ₈ "*	55"	25 ¹ / ₂ "	33 ¹ / ₂ " 29 ¹ / ₂ "†	32 ¹ / ₈ "
36 x 60	54 ³ / ₈ "*	67"	33"	45 ¹ / ₂ " 41 ⁷ / ₈ "†	32 ¹ / ₈ "
40 x 54	58 ³ / ₈ "*	61"	30 ¹ / ₈ "	39 ¹ / ₂ " 35 ¹ / ₄ "†	32 ¹ / ₈ "

Car Size	Width	Depth	Center of Rail	Center of Door	Clear Opening
36 x 48	54 ³ / ₈ "*	55"	28 ¹ / ₂ "	33 ¹ / ₂ " 29 ³ / ₄ "†	32 ¹ / ₈ "
36 x 60	54 ³ / ₈ "*	67"	32 ⁷ / ₈ "	45 ¹ / ₂ " 41 ⁷ / ₈ "†	32 ¹ / ₈ "
40 x 54	58 ³ / ₈ "*	61"	30 ¹ / ₈ "	39 ¹ / ₂ " 35 ¹ / ₄ "†	32 ¹ / ₈ "

Note:
All dimensions are to inside finished walls.


† Dimension when car gate is mounted opposite side from what is shown.

Hoistway Construction Notes


- Also see Drive Unit Area Construction Details on pages 14 and 15.
- A load bearing wall is required to sustain rail reactions.
See Rail Reactions and Guide Rail Backing Construction below.
- All points of the pit floor must be a minimum of 12" below the lower landing finished floor.
- Pit floor construction should withstand a 3200 lb. impact load.
- Hoistway sizes reflect running and access clearances only. *Consult your local authority to assure compliance with state and local codes.*
- Minimum overhead clearance is 9'-0" above the top landing finished floor. *(Optional 88" car height requires 9'-4", 94" car height requires 9'-10").*
- Due to limited clearances, it is imperative that the walls are square and plumb throughout the hoistway. The finished hoistway must be within 1/4" tolerance from top to bottom.
- Hoistway door provided by others. *We recommend a 3'-0" x 6'-8" door.*
- Hoistway is required to be free of all pipes, wiring and obstructions not related to the operation of the elevator.
- Service access hatch is required in the controller / drive assembly area. *See page 14 or 15 for recommended location.*
- Building structure must provide for a means of a chain hoist for hoisting rail and elevator materials to the top of the hoistway during installation.

Guide Rail Backing Construction Details:

- Rail backing consists of two (2) rails, mounted 14" apart at center. Follow the instructions below for each separate rail.
- Laminate (2) 2x8's and (2) 2x4's with glue and #8 x 2 1/4" wood screws (minimum).
- Overlap joints of the lumber as necessary for structural rigidity.
- Guide rail backing must be tied to a horizontal structural member (header or floor plate) at top, bottom and a maximum of 10' between.

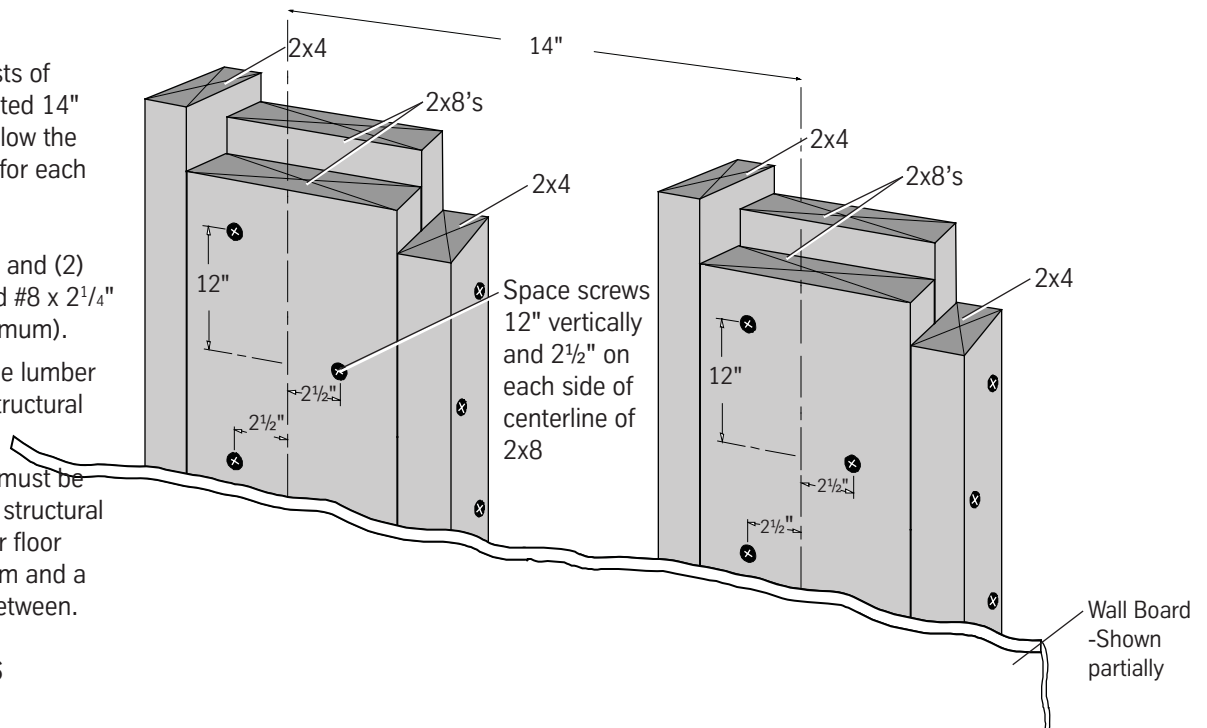

Rail Reactions




R1 = 210 LBF.

R2 = 543 LBF.

Rail reactions do not include safety factors. Applicable safety factors must be considered in hoistway design.

Wall attachment pull-out force is 147 LBF. per fastener.

Typical Gearless Motor Unit Area Construction Details:

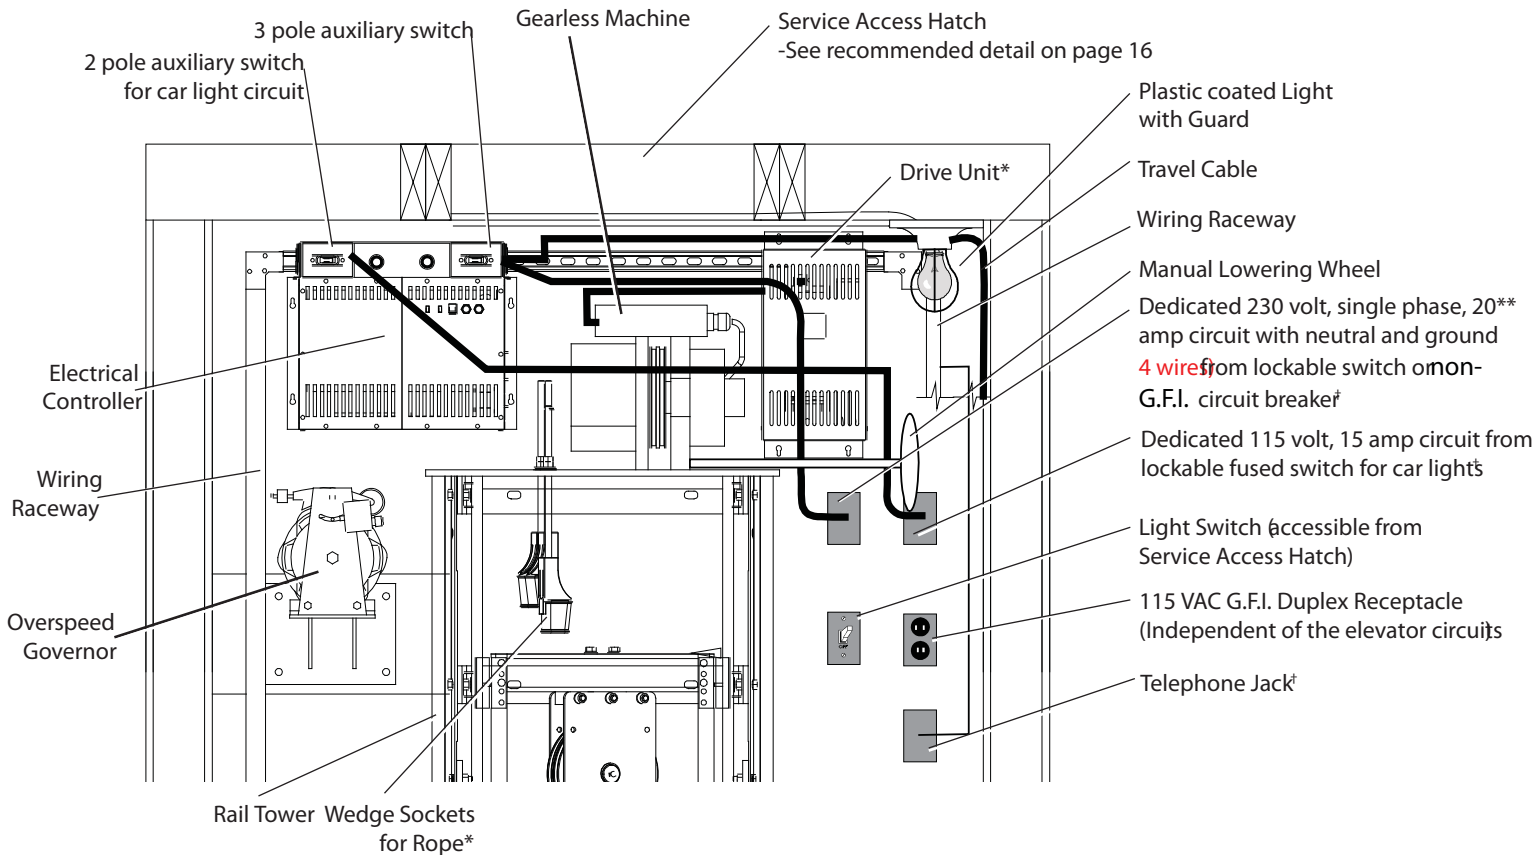

Section thru Top of Hoistway


*Equipment used for gearless drive only.

Construction Notes:


- Minimum overhead clearance for standard car is 9'-0" above the top landing finished floor.
- Light, light switch, receptacle, incoming electrical circuits and telephone jack to be located within 18" of the hoistway door wall to avoid interference with wiring raceway (or may be located in ceiling).

In Washington, we have to mount the controller and the drive unit in a remote location, see page 11.

Typical Gearless Hoistway Area Construction Details When Using Remote Located Controller:

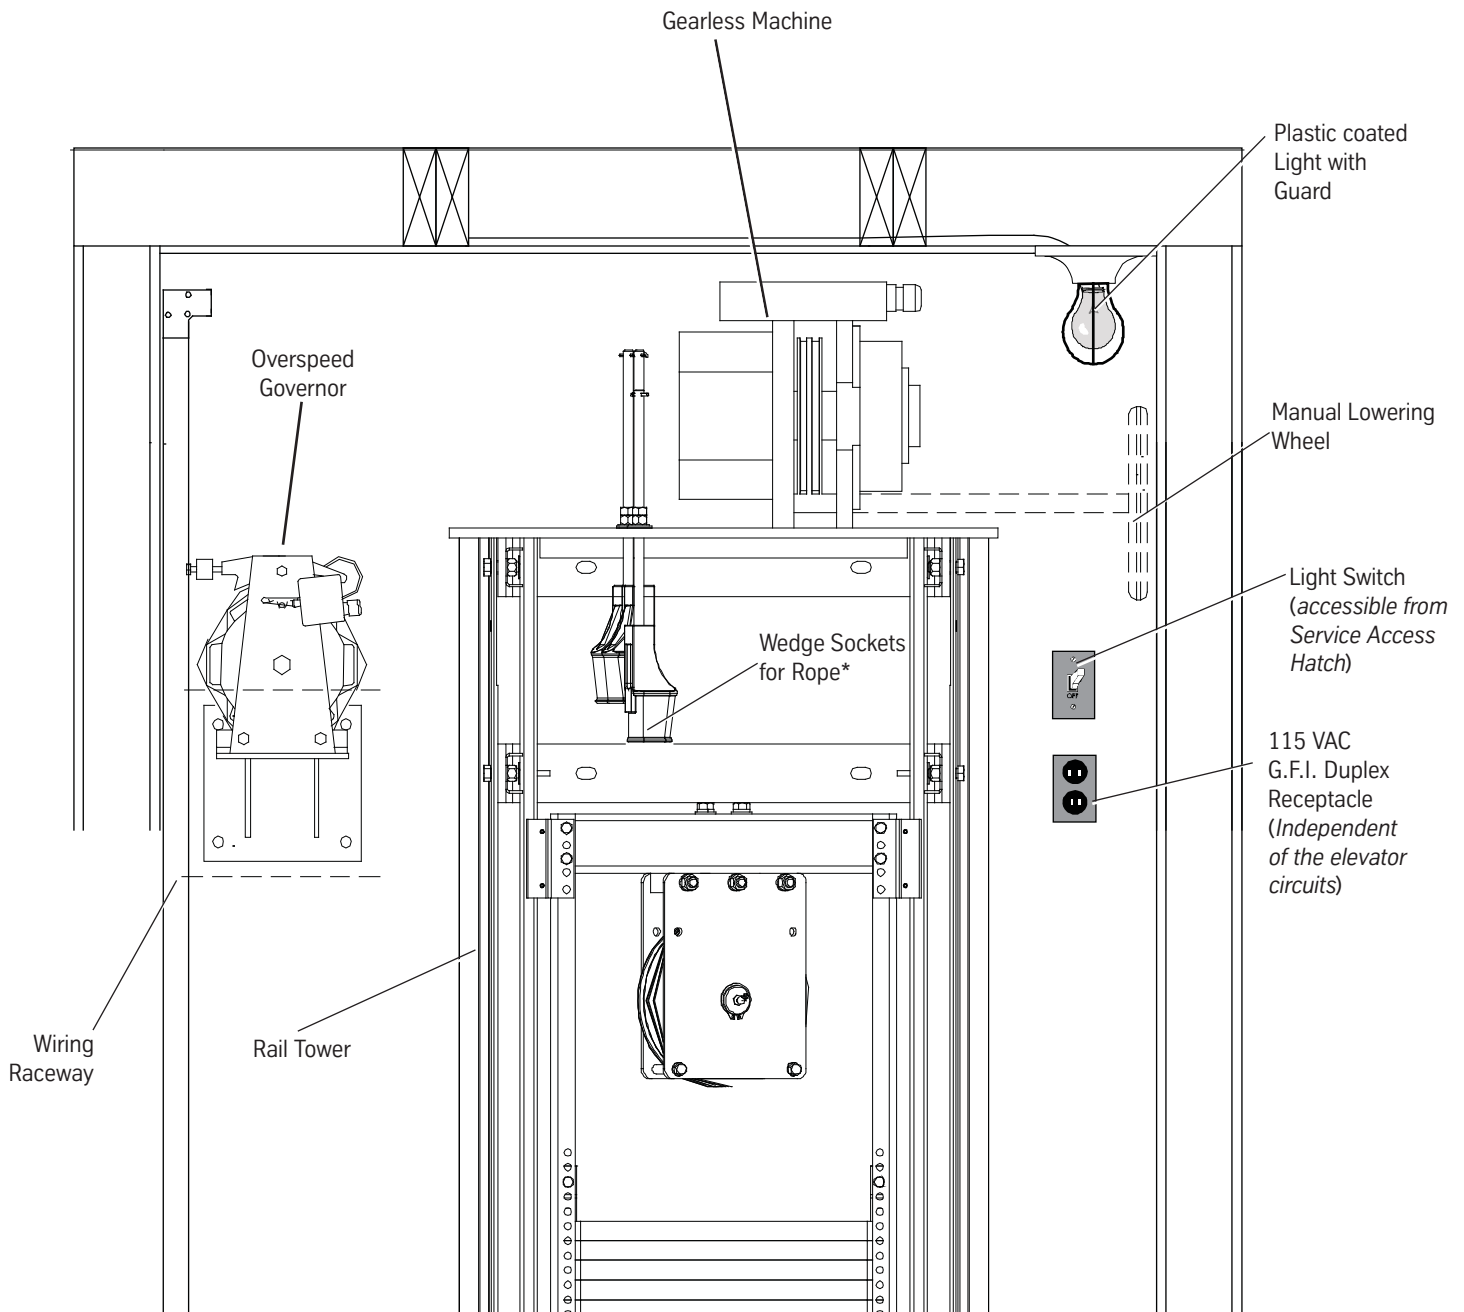


Remotely Located Controller Area Layout (Aerial View)

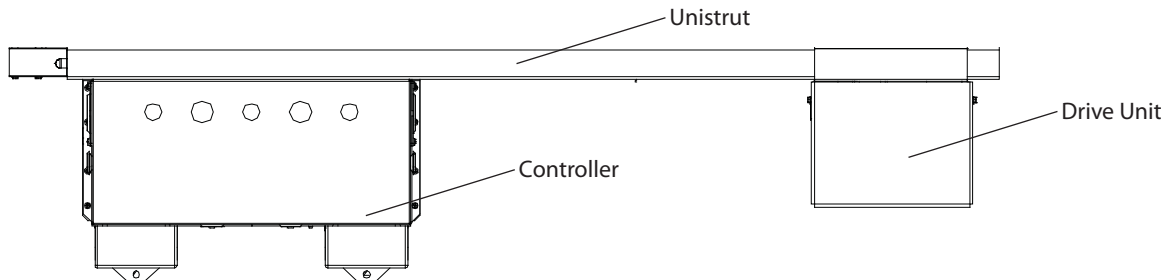

Requirements for remote located electrical controller:

- 42" wide x 36" deep work space
- dedicated 230V single phase, 20 amp circuit with neutral and ground (4 wires) from lockable 3 pole disconnect
- dedicated 115V , 15 amp circuit from lockable disconnect for cab lights
- telephone circuit

Service Access Hatch

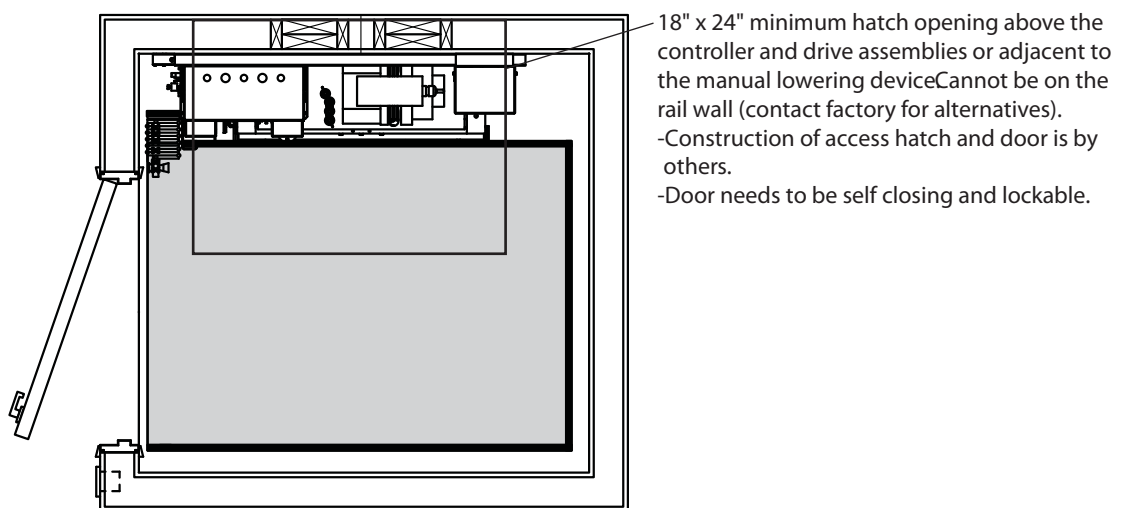

Plan View

Description of Features:

Car Operating Panel (Volant Signet features flush mounted operating controls)



Used to control the elevator from inside the car.

- Automatic car controls; buttons illuminate when call is registered.
- LED floor position display with system diagnostics that alerts the homeowner of complications that the control system may see.
- Emergency stop switch.
- Emergency alarm switch. Battery powered during power failure.
- Battery backup emergency light, integrated into the top of the panel, illuminates during power failure.
- Light switch to override the automatic car lights.
- Optional key switch available to limit access to authorized persons.
- Standard brushed stainless steel or brushed brass face. Also available in polished stainless steel or polished brass.

Hall Stations



Used to call the elevator to your floor.

- Automatic control.
- LED floor position display with system diagnostics that alerts the homeowner of complications that the control system may see.
- One provided for each floor level. Additional hall stations available for more than one opening per floor level.
- Standard brushed stainless steel or brushed brass face. Also available in polished stainless steel or polished brass.
- Optional key switch available to limit access to authorized persons.

Electrical Controller



Controls the electrical operation of the elevator.

- Located in the top of the hoistway near the drive unit.
- Programmable Logic Controller (PLC) with digital signal processor allows for SoftStart and SoftStop technology.
- Includes uninterruptible power supply (UPS) for floor selectable automatic lowering and operation of automatic car gate (if equipped). In case of power failure, the elevator can be lowered to another landing.
- Includes run/stop switch, automatic/remote switch and plug for construction/inspection pendant control.
- Can be located in a remote machine room for areas that do not allow the electrical controller to be located inside the hoistway.

Hoistway Door Interlocks



Locks the hoistway door when the car is not there.

- Surface mounted electromechanical interlock.
- Can be opened with a special key from outside the hoistway in case of emergency or for servicing.

Car Lights



Two recessed halogen car lights provided.

- Provided with stainless steel bezels.
- Automatically turns on when gate is opened and turns off 5 minutes after the elevator is used.
- Switch is provided on the car operating panel to provide constant on lights.
- Separate battery backup emergency light is integrated in the car operating panel that illuminates during power failure.
- As an option, wiring can be provided to the car top for connection to consumer provided lights.

Description of Features continued:

Automatic Car Gate Operator (optional on Volant, standard on Volant Signet)



Automatically opens the car gate when car stops at a floor.

- Mounts to top of car.
- Includes light beam safety curtain to keep gate open until path is clear.
- Closing speed slows the gate before full close.
- If car is already at floor level, the gate automatically opens when the hoistway door is opened.
- A door open button is provided on the car operating panel.

Auto-Opener™ (optional)



Automatically opens hoistway door when car stops at a floor.

- Mounts to wall near top of door on the hinge side. Backing is required by contractor.
- Works in conjunction with the automatic car gate operator.
- Automatically reverses when an obstruction is encountered.
- If car is already at floor level, door can be opened by pressing hall station button.
- Requires 115 VAC outlet near the top of the door on the hinge side at each landing.

Safety Devices

- Automatic bi-directional leveling. The elevator slows to a smooth stop.
- Terminal limits. Stops the elevator if it overruns the normal limits at the top or bottom landing.
- Final limits. A redundant safety feature if the elevator overruns the terminal limits at the top or bottom, the final limit stops the elevator and renders all automatic controls inoperable. If this happens, the elevator must be serviced to determine and correct the fault.
- Pit switch and car top switch. Disables elevator for servicing purposes.
- Interlocks. Hoistway doors remain locked when the car is not at that floor and prevent the elevator from running until all doors are closed.
- Slack rope safety device. In the unlikely event that a rope would slacken or break, the device locks the car onto the T-rails, preventing the car from falling.
- Car emergency stop switch. Located on car operating panel. Manual toggle switch disables elevator from inside car.
- Overspeed Governor. The Overspeed Governor will set the brakes should the rope fail. If the OSG fails, the elevator will become inoperable.

Volant Home Elevator with Gearless Drive

SECTION 14235
Residential Elevators

PART 1 GENERAL

1.01 SUMMARY

- A. The product described herein, manufactured by ThyssenKrupp Access, is a private residence home elevator designed and dimensioned to provide access to all levels to the home based on the individual's requirements.

1.02 REFERENCES

- A. Elevator shall be designed, manufactured and installed in accordance with the following standards:
1. American National Standards Institute (ANSI).
 2. American Society of Mechanical Engineers (ASME).
 3. International Building Code (IBC).
 4. National Electrical Code (NEC).
 5. American Society for Testing Materials (ASTM).
 6. American Welding Society (AWS).

1.03 SYSTEM DESCRIPTION

- A. Drive System: Geared machine with gearless drive and frequency controlled variable speed drive, 2 hp motor. Programmable logic controller with digital signal processor with automatic operation.
- B. Number of Stops: (specify:) Two to five.
- C. Car Configuration: (specify:) straight-thru, 90° side exit or enter/exit same side.
- D. Maximum Travel: (specify:) Up to 50'.
- E. Rated Load: (specify:) 700, 750 or 950 lbs.
- F. Rated Speed: 40 fpm.
- G. Car Size:
1. (specify:) 36"x48", 36"x60" or 40"x54" platform.
 2. (specify:) 84", 88" or 94" high ceiling.
- H. Car Walls: (specify:) Melamine panels (champagne, light oak, dark oak or white), wood veneer panels, inset wood veneer panels, or raised wood panels (oak, cherry, maple or birch).
- I. Car Ceiling: (specify:) White or wood veneer to match wall panels.
- J. Car Lighting: Two recessed halogen lamps with stainless steel bezel.
- K. Handrail: (specify:) To match wall panels, brass (brushed or polished), or stainless steel (brushed or polished).
- L. Operating Features:
1. Car Operating Panel: (specify:) Stainless steel or brass (brushed or polished) panel with illuminated automatic controls, light switch, emergency stop switch, alarm button and LED floor position/diagnostic display, and (specify option:) key lock.
 2. Hall Stations: (specify:) Stainless steel or brass (brushed or polished) panel illuminated button, LED position/diagnostic display and (specify option:) key lock provided at each landing.
 3. Pit Switch and car top run/stop switch.
 4. Uninterruptible power supply (UPS) for lowering and automatic gate operation (if equipped) in the event of a power failure.
 5. Automatic homing to (specify) floor.
 6. Telephone integrated into the control panel inside car.
 7. Car Gate(s): Accordion folding gate with safety switch (specify color:) champagne, chalk, white, light oak, dark oak, or clear panels.
 8. Upper and lower terminal limits.
 9. Final limits (2 upper and 1 lower).
 10. Slack rope safety.
 11. Drive circuit switch box (with auxiliary contacts) at controller.
 12. Light circuit switch box at controller.
 13. Battery backup emergency light and alarm.
 14. (specify option:) Telephone cabinet integrated into the elevator control panel.
 15. (specify option:) Automatic gate operator(s) with light beam safety curtain.

16. (specify option:) Buffer springs (requires 12" pit).

1.04 QUALITY ASSURANCE

- A. Manufacturer: Provide elevator manufactured by a firm with a minimum of 10 years experience in fabrication of elevators equivalent to those specified.
- B. All designs, clearances, workmanship and material, unless specifically accepted, shall be in accordance with all codes having legal jurisdiction.
- C. All load ratings and safety factors shall meet or exceed those specified by all governing agencies with jurisdiction and shall be certified by a professional engineer.
- D. Elevator shall be subject to applicable state, local and city approval prior to installation and subject to inspection after installation. Determination of and adherence to these regulations is the responsibility of the elevator contractor.
- E. Welders certified in accordance with requirements of AWS D1.1 shall perform all welding of all parts.
- F. Substitutions: No substitutions permitted.

1.05 WARRANTY

- A. Warranty: Manufacturer shall warrant component parts of the Volant home elevator for a period of two years after installation.

1.06 MAINTENANCE

- A. The Volant home elevator must be maintained in accordance with manufacturer's instructions.

PART 2 PRODUCT

2.01 MANUFACTURER

- A. Provide the Volant home elevator manufactured by ThyssenKrupp Access.
1. 4001 E. 138th Street, Grandview, MO

2.02 MATERIAL

- A. Guide Rail: Dual 6¹/₄ lbs. modular machined steel T-rail system.
- B. (2) ?" Diameter 8x19 Traction Ropes
- C. Sling: 1¹/₄" and 12 ga. structural and formed steel plates.
- D. Platform Floor: Unfinished plywood with removable insert for 2³/₄" flooring.

2.03 FINISHES

- A. Components shall be prepared with 1)alkaline detergent wash, 2)clear water rinse, 3)iron phosphate coating, 4)clear water rinse and finished with electrostatically applied and baked thermosetting powder coat finish for indoor or outdoor use. Standard color is ivory.

2.04 ELECTRICAL SYSTEMS

- A. The electrical contractors shall provide:
1. 230 VAC, 20 amp, 60 Hz, single phase power source with neutral and ground (4 wires) in the controller area.
 2. 115 VAC, single phase, 20 amp, 60 Hz power circuit in the controller area for the car lights.
 3. Telephone circuit in the controller area.

PART 3 EXECUTION

3.01 ACCEPTABLE INSTALLERS

- A. Installers shall be experienced in performing work of this section who have specialized in work comparable to that required for this project.
- B. Installers shall be certified and trained by the manufacturer.

3.02 EXAMINATION

- A. Use field dimensions and approved manufacturer's shop drawings to examine substrates, supports and other conditions under which this work is to be performed. Do not proceed with work until unsatisfactory conditions are corrected.

3.03 INSTALLATION

- A. The Volant home elevator shall be installed in accordance with manufacturer's instructions and as specified and approved by architect.
- B. Hoistway doors shall be installed by others.

3.04 DEMONSTRATION

- A. The elevator contractor shall make a final check of the elevator's operation with the Owner or Owner's representative present prior to turning the elevator over for use. The elevator contractor shall determine that operating and safety devices are functioning properly.

END OF SECTION

Notes: Intent of specification is to broadly outline equipment required but does not cover details of design and construction.

Dimensions and specifications are subject to constant change and continually evolving codes and product applications. For additional technical information, contact PRIMARIUS at 425-821-3160 or www.primariuselevator.com.

(continued on next page)



Volant Signet Home Elevator with Gearless Machine Drive

SECTION 14235
Residential Elevators

PART 1 GENERAL

1.01 SUMMARY

- A. The product described herein, manufactured by ThyssenKrupp Access, is a private residence home elevator designed and dimensioned to provide access to all levels to the home based on the individual's requirements.

1.02 REFERENCES

- A. Elevator shall be designed, manufactured and installed in accordance with the following standards:
 - 1. American National Standards Institute (ANSI).
 - 2. American Society of Mechanical Engineers (ASME).
 - 3. International Building Code (IBC).
 - 4. National Electrical Code (NEC).
 - 5. American Society for Testing Materials (ASTM).
 - 6. American Welding Society (AWS).

1.03 SYSTEM DESCRIPTION

- A. Drive System: Geared machine with counterweighted gearless drive and frequency controlled variable speed drive, 2 hp motor. Programmable logic controller with digital signal processor with automatic operation.
- B. Number of Stops: (specify:) Two to five.
- C. Car Configuration: (specify:) straight-thru, 90° side exit or enter/exit same side.
- D. Maximum Travel: (specify:) Up to 50'.
- E. Rated Load: (specify:) 700, 750 or 950 lbs.
- F. Rated Speed: 40 fpm.
- G. Car Size:
 - 1. (specify:) 36"x48", 36"x60" or 40"x54" platform.
 - 2. (specify:) 84", 88" or 94" high ceiling.
- H. Car Walls: (specify:) Metal frame with upper panel of glass, metal, laminate, stone or wood, lower panel of glass, metal, laminate, stone or wood.
- I. Car Ceiling: (specify:) Custom metal, laminate or wood.
- J. Car Lighting: (specify:) Two or four halogen lamps.
- K. Handrail: (specify:) Stainless steel or bronze (polished, brushed or decorative).
- L. Operating Features:
 - 1. Car Operating Panel: (specify:) custom metal, laminate or wood full length panel with flush mounted illuminated automatic controls, light switch, emergency stop switch, alarm button and LED floor position/diagnostic display, and (specify option:) key lock.
 - 2. Hall Stations: (specify:) Stainless steel or brass (brushed or polished) panel illuminated button, LED position/diagnostic display and (specify option:) key lock provided at each landing.
 - 3. Pit Switch and car top run/stop switch.
 - 4. Uninterruptible power supply (UPS) for lowering and automatic gate operation in the event of a power failure.
 - 5. Automatic homing to (specify) floor.
 - 6. Telephone integrated into control panel.
 - 7. Car Gate(s): Accordion folding gate with safety switch (specify color:) champagne, chalk, white, light oak, dark oak, or clear panels.
 - 8. Upper and lower terminal limits.
 - 9. Final limits (2 upper and 1 lower).
 - 10. Slack rope safety.
 - 11. Drive circuit switch box (with auxiliary contacts) at controller.
 - 12. Light circuit switch box at controller.
 - 13. Battery backup emergency light and alarm.

- 14. Integrated telephone cabinet.
- 15. Automatic gate operator(s) with light beam safety curtain.
- 16. (specify option:) Buffer springs (requires 12" pit).

1.04 QUALITY ASSURANCE

- A. Manufacturer: Provide elevator manufactured by a firm with a minimum of 10 years experience in fabrication of elevators equivalent to those specified.
- B. All designs, clearances, workmanship and material, unless specifically accepted, shall be in accordance with all codes having legal jurisdiction.
- C. All load ratings and safety factors shall meet or exceed those specified by all governing agencies with jurisdiction and shall be certified by a professional engineer.
- D. Elevator shall be subject to applicable state, local and city approval prior to installation and subject to inspection after installation. Determination of and adherence to these regulations is the responsibility of the elevator contractor.
- E. Welders certified in accordance with requirements of AWS D1.1 shall perform all welding of all parts.
- F. Substitutions: No substitutions permitted.

1.05 WARRANTY

- A. Warranty: Manufacturer shall warrant component parts of the Volant Signet home elevator for a period of two years after installation.

1.06 MAINTENANCE

- A. The Volant Signet home elevator must be maintained in accordance with manufacturer's instructions.

PART 2 PRODUCT

2.01 MANUFACTURER

- A. Provide the Volant Signet home elevator manufactured by ThyssenKrupp Access.
 - 1. Contact: 4001 E. 138th Street, Grandview, MO

2.02 MATERIAL

- A. Guide Rail: Dual 6¼ lbs. modular machined steel T-rail system.
- B. (2) ?" Diameter 8x19 Traction Ropes
- C. Sling: ¼" and 12 ga. structural and formed steel plates.
- D. Platform Floor: Unfinished plywood with removable insert for ¾" flooring.

2.03 FINISHES

- A. Components shall be prepared with:
 - 1. alkaline detergent wash
 - 2. clear water rinse
 - 3. iron phosphate coating
 - 4. clear water rinse and finished with electrostatically applied and baked thermosetting powder coat finish for indoor or outdoor use. Standard color for standard parts is ivory, standard color for metric parts is blue

(continued on next page)



2.04 ELECTRICAL SYSTEMS

- A. The electrical contractors shall provide:
 - 1. 230 VAC, 20 amp, 60 Hz, single phase power source with neutral and ground (4 wires) in the controller area.
 - 2. 115 VAC, single phase, 20 amp, 60 Hz power circuit in the controller area for the car lights.
 - 3. Telephone circuit in the controller area.

PART 3 EXECUTION

3.01 ACCEPTABLE INSTALLERS

- A. Installers shall be experienced in performing work of this section who have specialized in work comparable to that required for this project.
- B. Installers shall be certified and trained by the manufacturer.

3.02 EXAMINATION

- A. Use field dimensions and approved manufacturer's shop drawings to examine substrates, supports and other conditions under which this work is to be performed. Do not proceed with work until unsatisfactory conditions are corrected.

3.03 INSTALLATION

- A. The Volant Signet home elevator shall be installed in accordance with manufacturer's instructions and as specified and approved by architect.
- B. Hoistway doors shall be installed by others.

3.04 DEMONSTRATION


- A. The elevator contractor shall make a final check of the elevator's operation with the Owner or Owner's representative present prior to turning the elevator over for use. The elevator contractor shall determine that operating and safety devices are functioning properly.

END OF SECTION

Notes: Intent of specification is to broadly outline equipment required but does not cover details of design and construction.

Dimensions and specifications are subject to constant change and continually evolving codes and product applications. For additional technical information, contact PRIMARIUS at 425-821-3160 or www.primariuselevator.com.

Gearless Elevator Overview

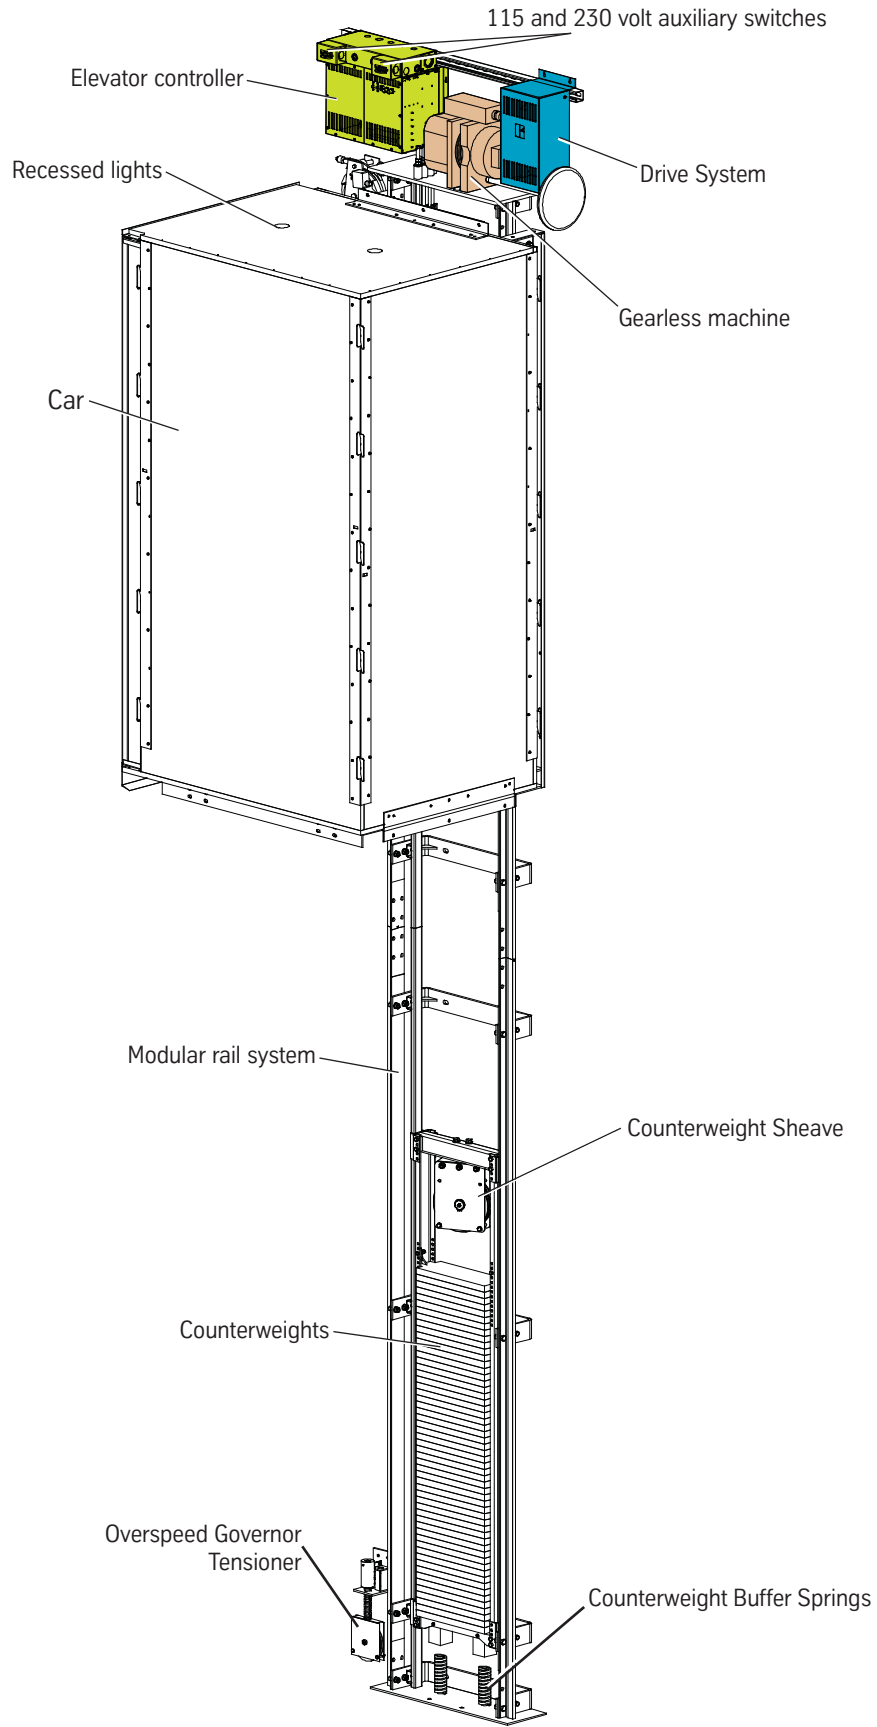



13M0308-IM400

ThyssenKrupp Access
4001 East 138th Street
Grandview, MO 64030-2837

425-821-3160
www.primariuselevators.com